




ALL BEDROOMS TO BE BE PROTECTED BY ARC FAULT CIRCUITS

SMOKE DETECTORS TO BE LOCATED PER CODE

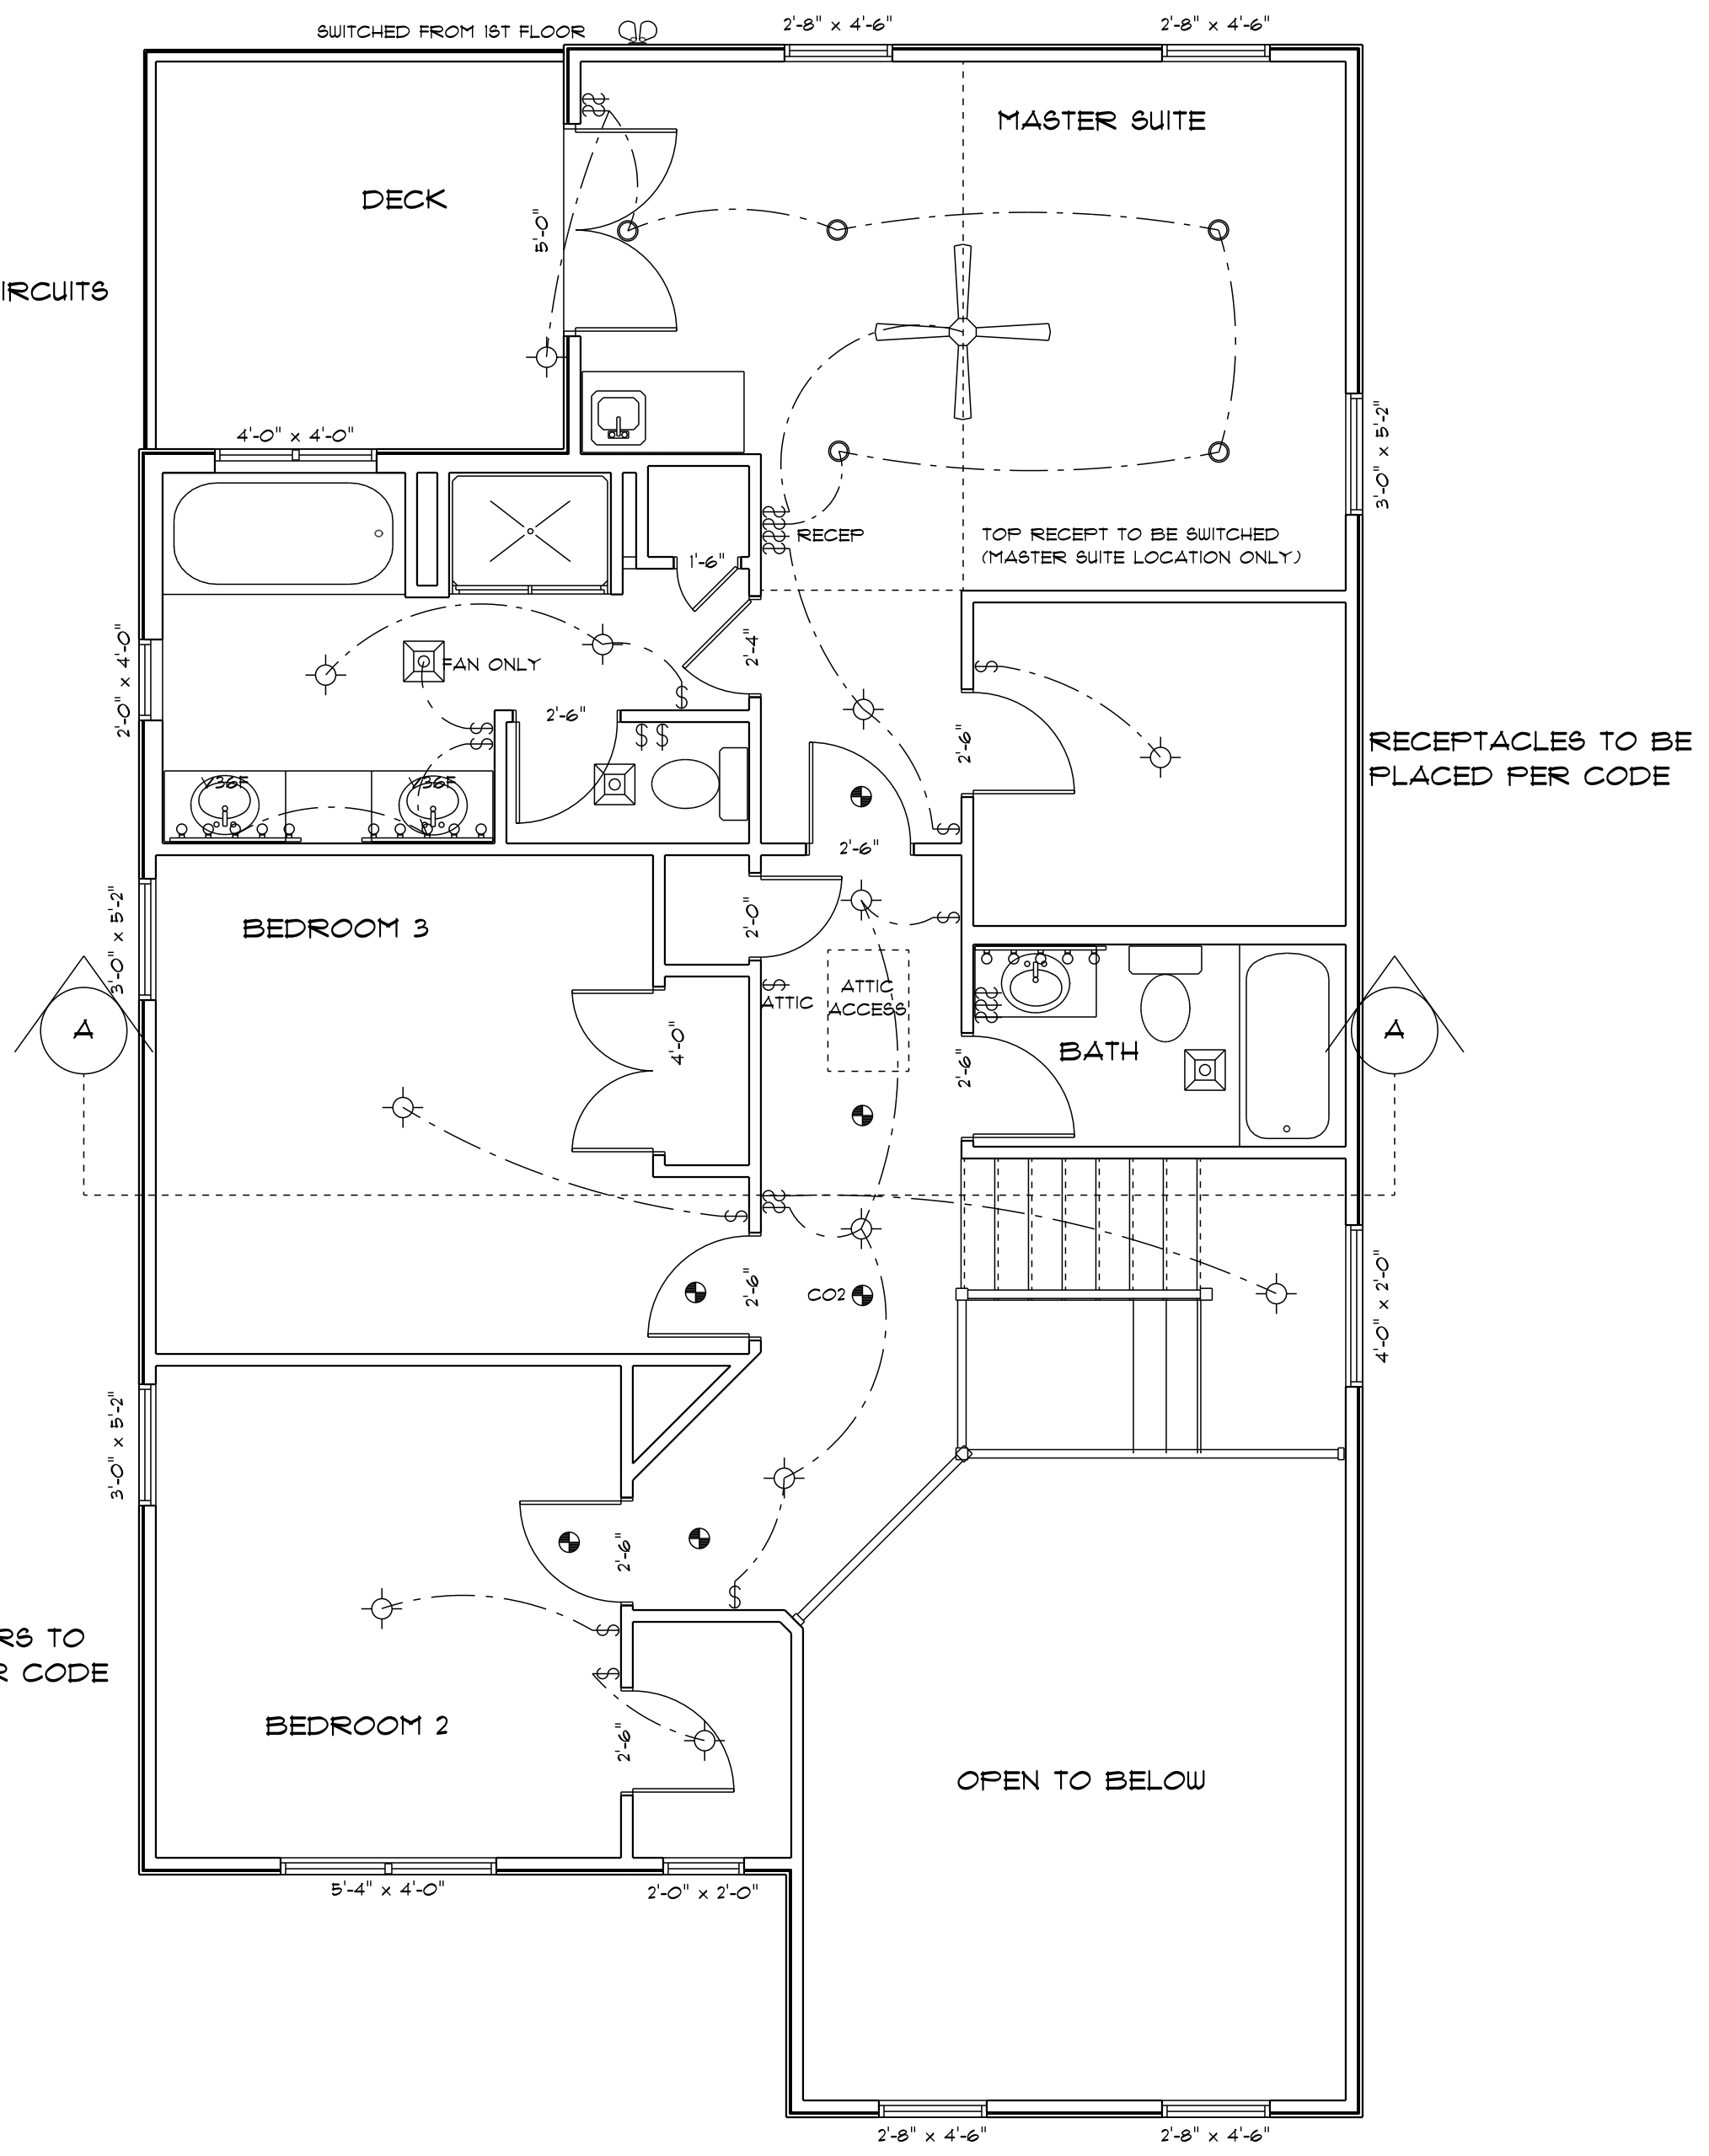

2ND FLOOR ELECTRICAL

APPROVED BY: JDO	DRAWN BY: S. HIXON	 <p>LOT 1 PIEDMONT BLACKSBURG, VA 24060</p>	<p>LOT 1 PIEDMONT BLACKSBURG, VA 24060</p>	SHEET
2006 IRC & VA USBC	SCALE 1/4" = 1'-0"	<p>2010 Rev. 02/27 Blairsville, VA 24149 Tel: (434) 382-2822 Fax: (434) 382-2822 www.highlanderconstruction.com</p>		
REVISION DATE:	NOV 15, 2008			